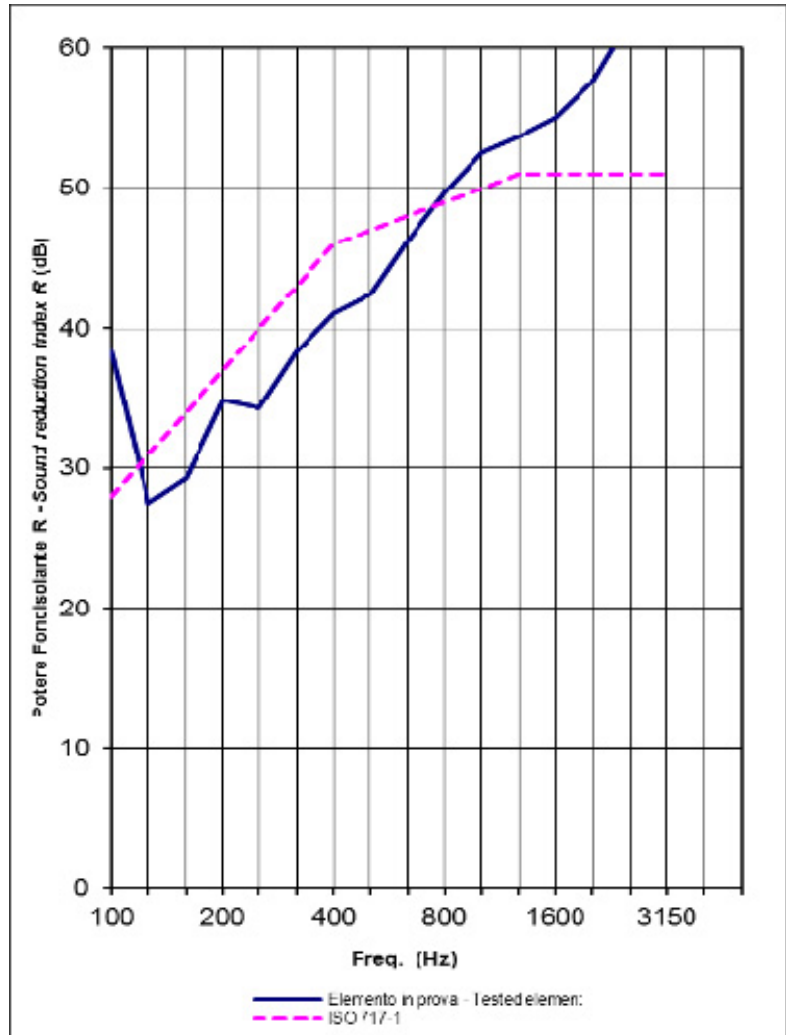



RISULTATI SPERIMENTALI / TEST RESULTS
Elemento in prova / Tested element **Parete vetrata DV72**
Caratteristiche / Characteristics Parete vetrata doppio vetro 66..2 acu
Glazing partition wall with double layer glass 66.2 acu

 Area del campione
Sample surface area S = **13,44** m²
 Volume della camera ricevente
Receiving room volume V = **85** m³
 Volume della camera emittente
Source room volume V = **97** m³

FREQ. Hz	R dB
100	38,3
125	27,5
160	29,3
200	34,9
250	34,3
315	38,3
400	41,1
500	42,4
630	46,2
800	49,7
1000	52,6
1250	53,6
1600	55,0
2000	57,6
2500	62,0
3150	64,4
4000	65,0
5000	66,4

R_w (C;C_{tr}) = 47 (-2 ; -6) dB

DATA
Date
09/05/2018
Settore Fisica delle Costruzioni
Building Physics Sector
G. De Napoli

B. U. Prodotto
B. U. Product
Ing. P. Fumagalli


 Documento firmato digitalmente ai sensi del D. Lgs. N. 82 del 7 Marzo 2005 e successive modifiche
Digitally signed document in accordance with Legislative Decree n. 82 dated March 7th 2005 and subsequent amendments.